


Type 9194/31-\*\*

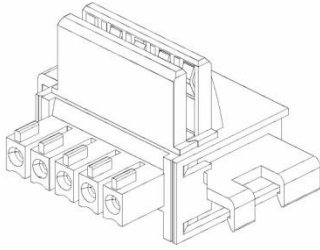


The pac-Bus Type 9194 is a nonincendive apparatus for installation in Non-Hazardous, Class I, Division 2 or Zone 2, Hazardous (Classified) Locations.

pac-Bus Type 9194/31-cd

cd = numeral 17 or 22 for grid size

Type 9195/\*\*\_\*\*\_\*\*\*\*

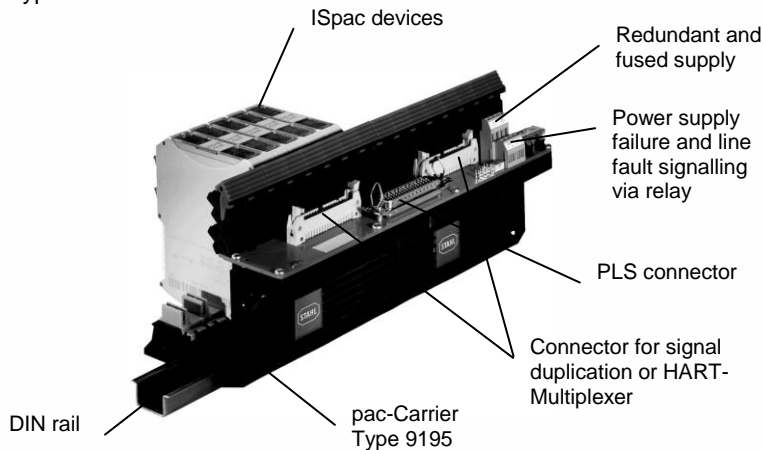

The pac-Carrier Type 9195 is a nonincendive apparatus for installation in Non-Hazardous, Class I, Division 2 or Zone 2, Hazardous (Classified) Locations.

pac-Carrier Type 9195/abc-def-ghij

ab = numeral 08, 16 or 24 for slots, alternatively a = numeral 1 to 9 for slots and b = numeral 1 or 2 for used channels per slot

c = letter A, H, M, N, P, S or T for model

de = letters for manufacturer of automation system

f = numeral for type of automation system

gh = numeral for I/O-module

ij = letter plus numeral for system-specific connector for process control system

Notes:

1. Installation should be in accordance with Article 504/505 of the National Electrical Code, ANSI/NFPA 70 and ANSI/ISA RP 12.06.01.
2. Installation in Canada should be in accordance with the Canadian Electrical Code, CSA C22.1, Part 1, Appendix F.
3. Use a general purpose enclosure meeting the requirements of IEC 61010-1 for use in Non-Hazardous or Class I, Division 2, Hazardous (Classified) Locations.
4. Use an FM Approved Dust-ignition proof enclosure appropriate for environmental protection in Class II, Division 1, Groups E, F and G; and Class III, Hazardous (Classified) Locations.
5. These devices are to be mounted on DIN rail.
6. Ambient temperature: -20°C ... +70°C (any mounting position; pay attention on the I.S. isolator's specifications)

WARNING: Do not disconnect equipment when a flammable or combustable atmosphere is present.

AVERTISSEMENT: Ne pas débrancher l'équipement en présence d'atmosphère inflammable ou combustible.

The safety relevant statements of this document may be transferred into the operating instructions.

Transferring the text, editorial changes of equivalent meaning are allowed.

			2007	Date	Name	Certification drawing	Scale
			drawn	04.05.	Einsiedler		none
			checked		Kaiser		Sheet
						pac-Bus, Type 9194/31-** pac-Carrier, Type 9195/**_**_****	1 of 1
02	15.10.12	Reistle				91 956 01 31 1	Agency
01	24.08.11	Reistle					FM
Version	Date	Name	Ers. f.			Ers. d.	A4